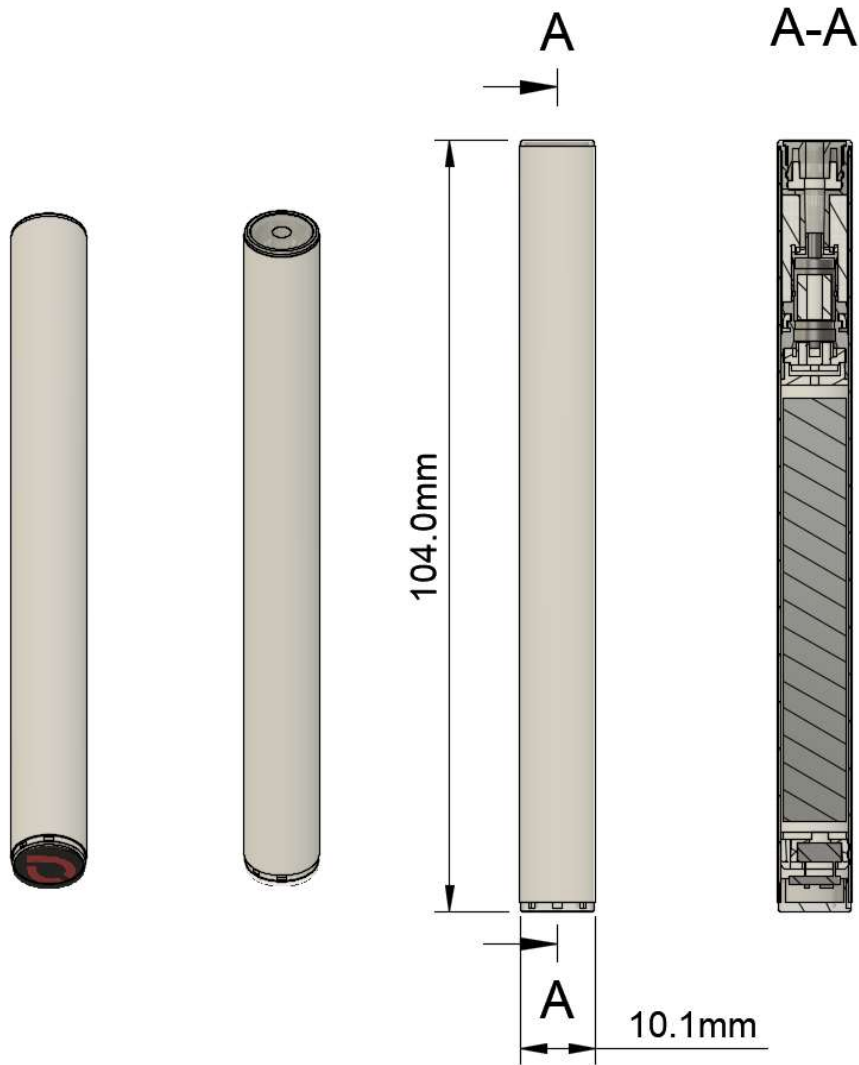

	DOCUMENT NO:	CDS-LX3234-13XX	VER:	1.3
	Liquid eXpendable (LX); 0.5 ml			EFFECTIVE DATE:
APPROVAL:	ECO-116	Jupiter PN(s):	LX3234-13XX	PAGE 1 OF 3




Description: All-in-one disposable vape pen, top fill cartridge design

Features:

- CCELL Technology atomizer – heating element embedded in porous ceramic
- Breath actuated
- 340 mAh Li-ion battery cell
- Crushproof SS cartridge housing
- Tamper resistant press-fit mouthpiece
- Operational viscosity range up to 110,000 cPs

	DOCUMENT NO:	CDS-LX3234-13XX	VER:	1.3
	Liquid eXpendable (LX); 0.5 ml			EFFECTIVE DATE:
APPROVAL:	ECO-116	Jupiter PN(s):	LX3234-13XX	PAGE 2 OF 3

Specifications		
Internal Volume	Gross	0.55 ml
	Max. fill volume	0.50 ml
Weight, empty with Mouthpiece	7.5 ± 0.2 grams	
Atomizer Resistance	1.35 ± 0.15 Ω	
Fluid Inlet Hole Diameter	2.0 mm	
Maximum Viscosity	110,000 cPs	
Wetted Materials	Housing	SS
	Mouthpiece	Eng. Thermoplastic (proprietary)
	Atomizer shell and base	SnCo-plated brass
	Airway tube	SnCo-plated brass
	Heating element	Nichrome
	Wick	Ceramic
	Atomizer retaining wrap	Cellulose
	Seals	Silicone
	Battery Housing	Polycarbonate (PC)
Battery Cell Capacity	340 mAh Li-ion	
Max. Current Output	3 A	
Safety Features	Short-Circuit Protection	Output deenergizes with load ≤0.8 Ω. LED lights and remains on for 2 – 3 seconds to indicate a short.
	Over-Usage Protection	Output is deenergized after 10 seconds (±20%) of continuous activation. LED flashes twice.
Low Battery Indication	LED flashes 10 X	
Branding Options	Available with MOQ	

	DOCUMENT NO:	CDS-LX3234-13XX	VER:	1.3
	Liquid eXpendable (LX); 0.5 ml			EFFECTIVE DATE:
APPROVAL:	ECO-116	Jupiter PN(s):	LX3234-13XX	PAGE 3 OF 3

Jupiter Liquid X Filling Instructions

1. Insert a blunt tipped needle in the crescent shaped opening. Holding upright fill the reservoir with 0.5 ml of oil.
- * Do not overfill or allow oil to enter the center airway.
2. Immediately after filling, insert and press fit the mouthpiece until it is fully seated.
- * Failure to insert the mouthpiece immediately may cause leakage.

Waiting 30 minutes for atomizer to saturate is recommended before use.

For Technical Assistance please contact us at:
cs@jupiterresearch.com

Mouthpiece



Insert Filling Needle Here

